



Cable trenches at side of road omitted for clarity. Cables may be installed in verges

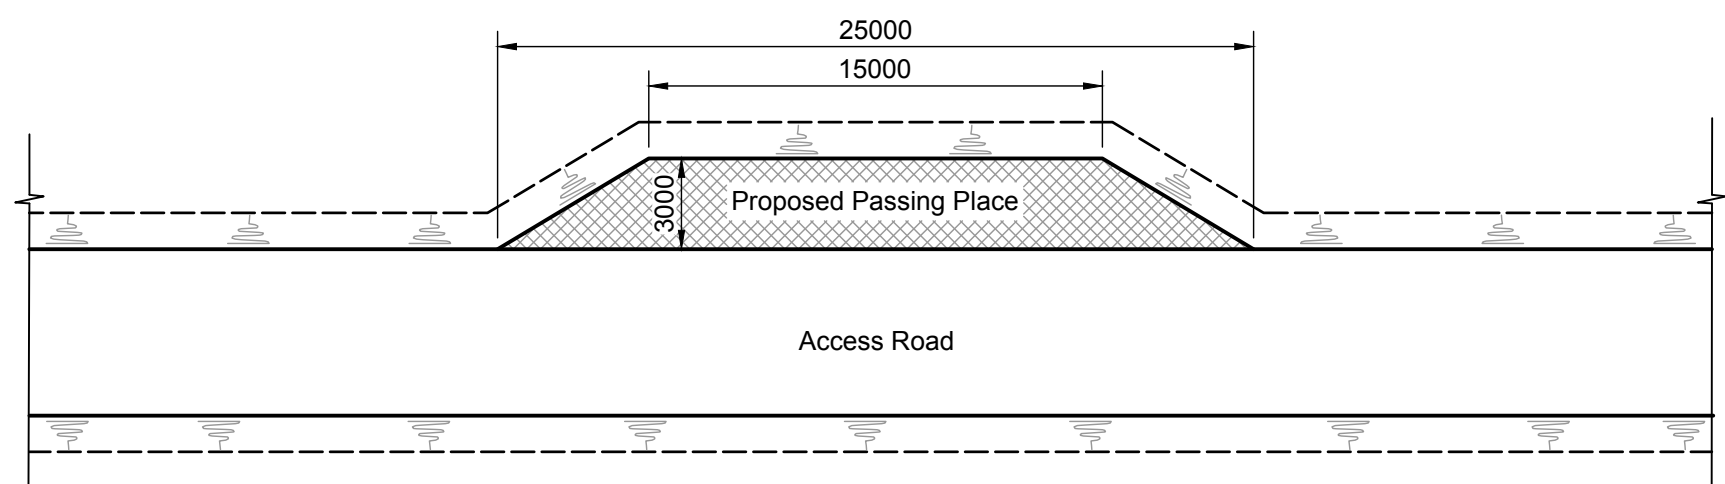

**Notes**  
1. All dimensions are in millimetres (mm) unless stated otherwise.

**Figure 4.4**  
**Typical Access Track Details**  
Gordonbush Extension Wind Farm  
EIA Report